FIRE SCREEN FS EI2-120

INSTALLATION REQUIREMENTS

edition 1,
March 2019

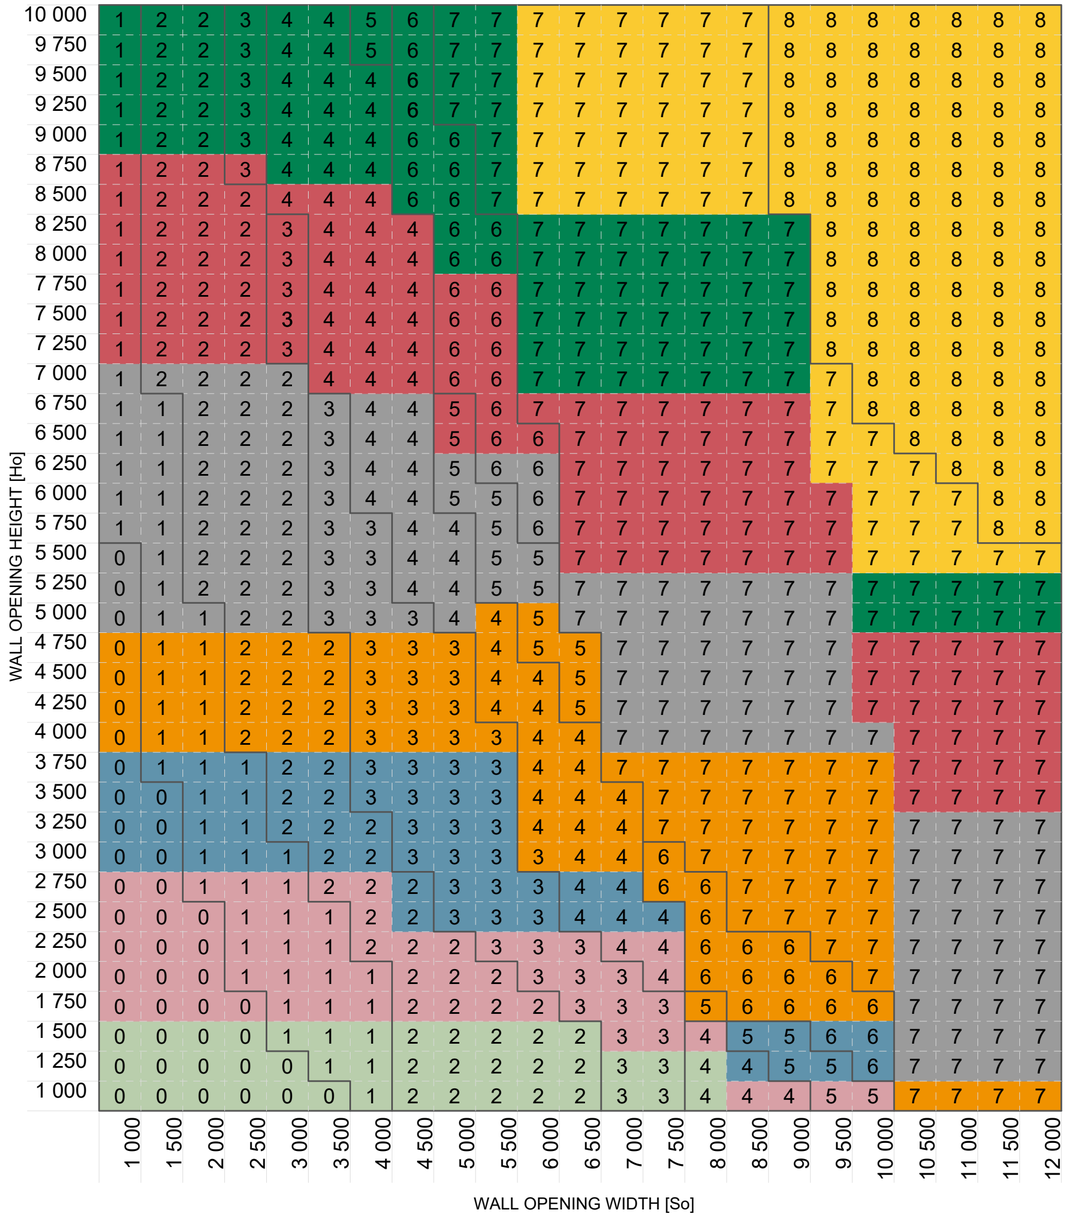

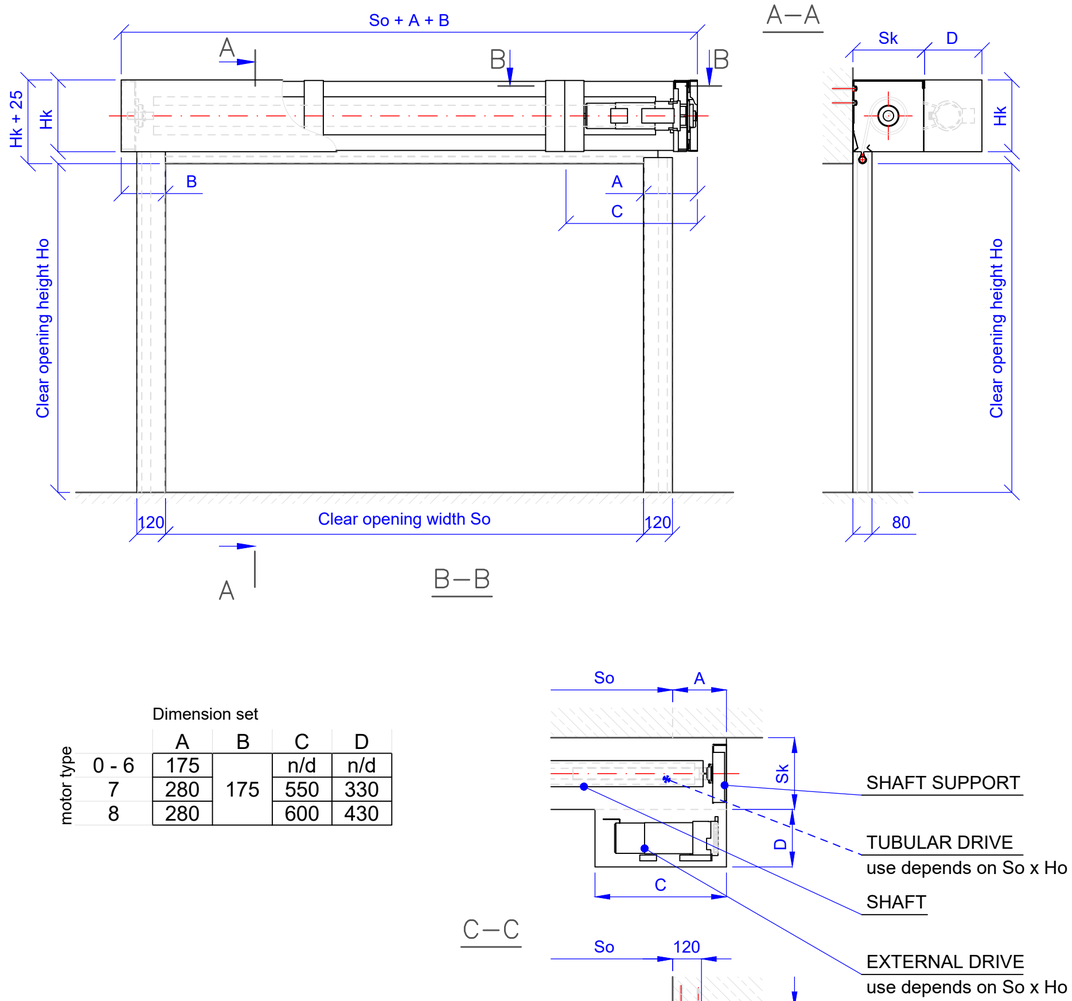

Dimension set

motor type	A	B	C	D
0 - 6	175	175	n/d	n/d
7	280		550	330
8	280		600	430

DESCRIPCTION
- required dimensions
  for cassette Sk x Hk [mm]:

- 325 x 350
- 375 x 400
- 425 x 450
- 475 x 500
- 525 x 550
- 575 x 600
- 625 x 650
- 675 x 700

DESCRIPCTION
- dedicated electric drive:

Nr 0 - 6 are with Simu tubular motor 230V
Nr 7 - 8 are with External motor 400V

Notice:
- drawing assumptions:
  - drive on the right,
  - shaft - lintel mounting,
  - guides - wall mounting;
- shaft could be ceiling mounted with additional e.g. light structure in height min. h = Hk and required fire protection class;
- guides could be niche mountedst with additional e.g. light strucrures in width min. A (drive side) and B (opposite side);
- Next Door Systems B.V. reserves the right to make changes in this guidelines;